


SMOKE DETECTOR PLAN

- NOTES:
1. FOR GENERAL NOTES, LEGEND, REVISIONS, SEE DRAWING F-1-2-1.
 2. ALL ADDRESSABLE SMOKE DETECTORS CIRCUITS SHALL BE RUN TO EXISTING ATC CABINET.
 3. THE CONTRACTOR SHALL DISCONNECT AND REMOVE THE OLD (EXISTING) SMOKE DETECTORS SHOWN TO BE REMOVED ONLY AFTER THE INSTALLED DEVICES ARE OPERATIONAL AS DIRECTED AND IN THE PRESENCE OF THE ENGINEER.
 4. REFER TO THE MECHANICAL DRAWING M-1 FOR THE REQUIREMENTS AND THE LOCATIONS OF THE FLEPMAN SMOKE DETECTORS.
 5. CONTRACTOR SHALL LOCATE ALL SMOKE DETECTORS PER BUILDING CODE.

GOURMET FOOD CENTER

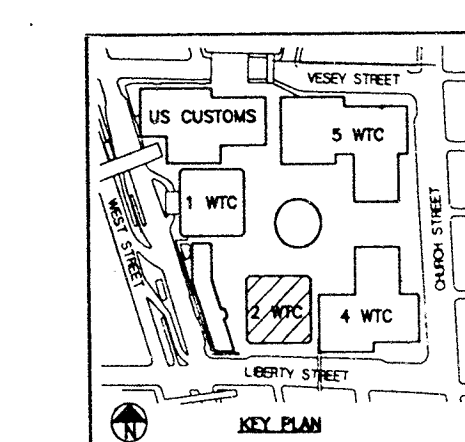

Sheet 01

THE PORT AUTHORITY
OF NY & NJ



Joseph R. Loring
& Associates, Inc.
consulting engineers

One Pennsylvania Plaza
New York, New York 10119-0045
Tel: (212) 563-7400
Fax: (212) 563-7382

SCR Design Organization, Inc.
architects
305 EAST 45 STREET
NEW YORK, N.Y. 10017
TEL: (212) 421-3500

1	5/24/98	AS BID	DC
No.	Date	Revision	Approved

Engineering Department
Design Division
The World Trade
Center

Title
TOWER 2
FLOOR 78
FIRE ALARM
SMOKE DETECTOR
INSTALLATION AND
REMOVAL PLAN

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.

F.D.	F.D.	4565.000
Designed by	Drawn by	JRLA JOB No.
4/27/98	P.E.N.	3/32"=1'-0"
Date	Checked by	Scale
Contract Number	Drawing Number	
WTC-B57.090	F-2-78-2	